

AIR CONDITIONING JOBSITE INFORMATION SHEET

➤ OWNER

Name: _____

➤ DISTRIBUTOR

Name _____

City _____ State/Province _____

➤ CONTRACTOR

Name: _____

City: _____ State/Province: _____

➤ EQUIPMENT DATA:

OUTDOOR UNIT

Model#: _____ Serial # _____ Date Installed: _____

EVAPORATOR

Model#: _____ Serial # _____ Date Installed: _____

AIR HANDLER/FURNACE

Model#: _____ Serial # _____ Date Installed: _____

➤ PROBLEM SUMMARY:

➤ CORRECTIVE ACTIONS TAKEN:

➤ ADDITIONAL INFORMATION:

➤ Return Air Static Pressure: _____ Supply Air Static Pressure: _____ Total Static Pressure: _____ Low Voltage: _____ V

➤ Compressor Winding Resistance Common-Run ___ Common-Start ___ Run to Start ___
Common-Ground ___ Start to Ground ___ Run to Ground ___

➤ ACCESSORIES? (CHECK THOSE INSTALLED):

- | | |
|--|---|
| <input type="checkbox"/> Low Ambient | <input type="checkbox"/> High Pressure Cutout |
| <input type="checkbox"/> Compressor Time Delay | <input type="checkbox"/> Low Pressure Cutout |
| <input type="checkbox"/> Mild Weather Kit | <input type="checkbox"/> Other: _____ |
| <input type="checkbox"/> Crankcase Heater | _____ |
| <input type="checkbox"/> Hard Start Kit | _____ |
| <input type="checkbox"/> Filter-Drier | _____ |

Technician: _____

Date: _____

Internal Use Only:

Allied Tech: _____

Case Number: _____

Date Requested: _____

Date Received: _____



AIR CONDITIONING JOBSITE INFORMATION SHEET

REMEMBER:



1. Circle Metering device used.
2. Circle Yes or No at drier locations.
3. Circle Service Ports used.
4. Sat. Temp. is pressure converted to Temp.

Formula For Super Heat

Vapor Line Temp.	
-	Sat Temp.
Equals Super Heat	

Formula For Sub Cooling

	Sat Temp.
-	Minus Liquid Line Temp.
Equals Sub Cooling	

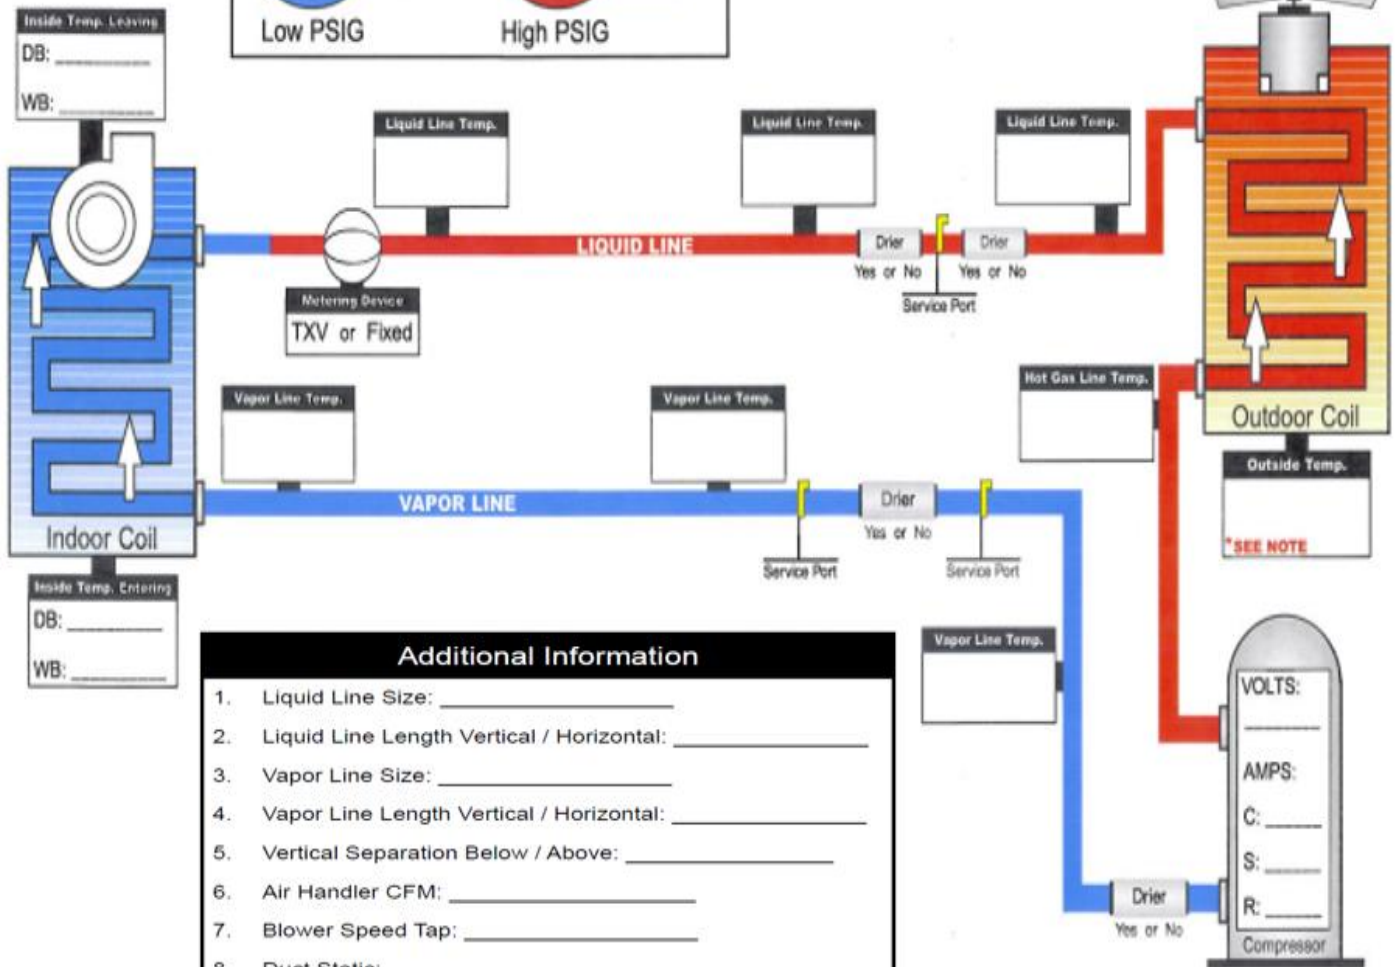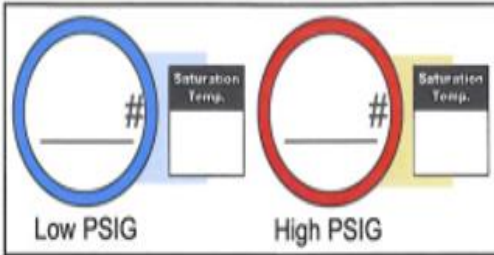

Additional Information

1. Liquid Line Size: _____
2. Liquid Line Length Vertical / Horizontal: _____
3. Vapor Line Size: _____
4. Vapor Line Length Vertical / Horizontal: _____
5. Vertical Separation Below / Above: _____
6. Air Handler CFM: _____
7. Blower Speed Tap: _____
8. Duct Static: _____
9. Unit Voltage (off): _____
10. Unit Voltage (running): _____

NOTE: Outdoor Ambient Temp.

